



J. K. White Cement Works

(Unit of JK Cement Ltd.)



CIN : L17229UP1994PLC017199

ISO 9001, ISO 14001, ISO 45001, ISO 50001 & SA 8000 Certified

P.O. GOTAN - 342 902 District - Nagaur (Rajasthan) INDIA

Phone : (01591) 230201-03 (PBX), 230976 (D), Fax : 230206

Reg. A/d & Mail

JKWC (TPP)/PLNG/ENV/21/

Date: 24.05.2022

The Director,
Ministry of Environment, Forest & Climate Change
Integrated Regional Office,
A-209 & 218, "ARANYA BHAWAN", Jhalana Institutional Area, Jaipur-302004
Tel No: 0141-2713786, 2713778 Email: iro.jaipur-mefcc@gov.in

Subject : Compliance of Environmental Clearance conditions for 7.5 MW TPP.
Sir,

Please find below the point - wise reply of the compliance conditions communicated vide letter No. J-13012/187/07-IA-II(T) dated 31.12.2007 from MoEF, New Delhi for 7.5 MW TPP.

Project Code: Raj – 32/581/08

Name of the Project : 7.5 MW Captive Power Plant
Clearance Letter No. : J-13012/187/07-IA-II(T) dated 31.12.2007

Period of Compliance Report : 1st October, 2021 to 31st March, 2022.

Compliance Conditions:

S. No.	Conditions	Compliance Status
1.	No additional land shall be acquired for any activity relating to the proposed project.	The present plant is in the same premises of J K White Cement Works.
2.	Sulphur contents in coal and lignite to be used as fuel for the project shall not exceed 0.7 % and 1.0 % respectively. In the event of the sulphur content exceeding the prescribed limits, lime treatment shall be given to control SO ₂ emission by at least 90%.	Coal, lignite has been used for power generation having sulphur content below 0.7 % & 1 % respectively. If the sulphur contents found more then prescribed limit lime treatment will be given.
3.	The height of the stack shall be as per the standards prescribed under the Environment (Protection) Act in this regards or 72 m, which ever is more with continuous online monitoring system. The exit velocity of the flue shall not be less than 18 m/sec.	The stack of 72 m height is provided.
4.	High efficiency electrostatic precipitators (ESPs) shall be installed to limit particulate emission to 100 mg/Nm ³ .	Three stages ESP has been installed. (ii) Stack opacity meter installed result display in CCR. We have online connected with RSPCB & CPCB servers. we are achieving <50 mg/Nm ³ particulate emission

Regd. Office

J.K. Cement Ltd.
Kamla Tower, KANPUR-208001
Ph. : 0512-2371478-83
Fax : 0512-2399854
Email : ho.white@jkcement.com
Website : www.jkcement.com

Delhi Office

Padam Tower, 19, DDA Community Centre
Okhla, Phase-I, New Delhi-110020
Ph. : EPBAX-011-49220000
Fax : 011-49220044
Email : jkwc.delhi@jkcement.com

Jodhpur Office

182, Gopi Krishna Vihar,
Near Gura Ka Talab,
Near Pratap Nagar, Jodhpur-342001
Ph : 0291-2432021, 2433072
Fax : 0291-2433071
Email : jodhpur.office@jkcement.com


PRODUCERS OF HIGH QUALITY WHITE CEMENT & WALL PUTTY



5.	Dust extraction and suppression system and water sprinklers shall be provided for controlling fugitive dust during transportation, in coal /lignite storage & handling area and other vulnerable areas of the plant.	We have already taken care for controlling the fugitive dust emission by adopting the better house keeping, concreting the movement areas and development of Green belt. Dust collectors have been installed at crusher house, Transfer Tower No. 1 & at Bunker top. Water sprinkle system has been provided at Grizzly Hopper for controlling of dust.
6.	Water requirement shall be met from the saving of water to be achieved with the replacement of DG sets and from STP. No additional water shall be extracted for the project.	Total water requirement of the project is 200 KL/D, out of which 62 KL has been met from STP treated water & 138 KL/D met as substitute of phased out DG set which is presently not in running due to TPP.
7.	Air cooled condenser shall be provide	Air Cooled condenser is provided
8.	The treated effluent shall be re-circulated and reused within the plant area. There shall be no waste discharge outside the plant boundary.	Wastewater discharge from various processes from thermal power plant. After proper treatment it is used for dust suppression & in green belt development. There is no water discharge out side the plant boundary.
9.	Rainwater harvesting shall be practiced. A detailed scheme for rain water harvesting to recharge the ground water aquifer shall be prepared in consultation with Central Ground Water Authority /State Ground Water Board and a copy of the same shall be submitted within three months to this Ministry.	We are provided very well rainwater harvesting system according to CGWA guidelines.
10.	Leq of Noise level shall be limited to 75 dB (A) and regular maintenance of equipments should be undertaken. For people working in high noise areas, personal protection devices should be provided.	Regular noise monitoring shall be ensured around plant boundary within stipulated norms. Recognized approved lab Report Annexure- 1
11.	Dry ash collection system shall be provided. 100 % ash utilization shall be ensured from the day one of the commissioning of the plant.	Arrangement for collection of dry ash has been provided. The 100 % flyash/Cinder shall be utilized in our own and grey cement plant situated about 1 km from TPP as well as sister concern cement plants.
12.	A green belt shall be developed around the plant boundary with tree density of at least 1500 per ha covering 1/3 rd of the project area	Tree sapling of Neem, Desi Ashok, Pendular Ashok, Arjun etc. has been planted around the TPP boundary side & nearby area also maintained more then 1/3rd project area. Annexure-2



13.	First aid and sanitation arrangements shall be made for the drivers and other contract workers during construction.	Sanitation facilities for operators/workers have been provided.
14.	Regular monitoring of the ambient air quality shall be carried out in and around the power plant and records maintained. The location of monitoring stations and frequency of monitoring shall be decided in consultation with the State Pollution Control Board. Periodic reports shall be submitted to the Regional Office of this Ministry at Lucknow.	The TPP is in the same premises of J K White Cement Works hence four manual AAQM stations are monitored regularly in consultation with Regional Office for the parameters of SPM/PM₁₀PM_{2.5}, SO₂, NO_x & CO. Results are well within the stipulated norms & results have been sent to concerned departments. Four number CAAQMS Station installed as per guidelines and connected to RSPCB and CPCB servers for online monitoring. Approved Lab monitoring report attached annexure -1
15.	The project proponent shall advertise in at least two local newspaper widely circulated in the region around the project, one of which shall be in the vernacular language of the locality concerned within seven days of issue of this letter, informing that the project has been accorded environmental clearance and copies of clearance letter are available with the State Pollution Control Board/Committee and may also seen at Website of the Ministry of Environment & Forest at http://enfor.nic.in	Grant of Environmental Clearance has advertised in Rajasthan Patrika & Dainik Bhasker on dated 03.01.2008.
16.	A separate environment management cell with qualified staff shall be set up for implementation of the stipulated environmental safeguards.	Environment Department has been setup for environmental management and Unit Head to look after about the total control of pollution, monitoring & maintenance of pollution control devices with the help of Technical Head, Manager (Mechanical) along with Environment Department Officers, Environment Supervisor, Engineer (Chemical) & a trained team.
17.	Half yearly report on the status of implementation of the stipulated conditions and environmental safeguard shall be submitted to this Ministry, the Regional Office, and the CPCB / SPCB.	Complete Report is submitted to all concerned departments within time frame as directed.
18.	Regional Office of the Ministry of Environmental & Forests located at Lucknow will monitor the implementation of the stipulated conditions. A complete set of documents submitted to this ministry shall be forwarded to the Regional Office for their use during monitoring.	The complete set of documents is forwarded to concerned departments.
19.	Separate funds shall be allocated for implementation of environmental protection	The total cost of project is 43 crore out of which Rs. 339 Lacs invested for Env. Protection



	measures along with item-wise break-up. These cost shall be include as part of the project cost. The funds earmarked for the environment protection measures shall not be diverted for other purpose and year-wise expenditure shall be reported to the Ministry.	measures & Rs. 29 Lacs kept for recurring expenditure on environmental protection.
20.	Full cooperation shall be extends to the Scientist/Officers from the Ministry / Regional Office of the Ministry at Lucknow / the CPCB / the SPCB who would be monitoring the compliance of environmental status.	Agreed

Occupational health surveillance report attached. **Annexure-3.**

We hope you will find the document in order. Kindly acknowledge the receipt.

Thanking you,

Yours faithfully

For J K White Cement Works



Dr. Ranjeet Kumar Bagariya
(Environment Head)

Encl.: Complete report with Annexure- 1 to 3 (Page 1 to 14)

Cc: Central Pollution Control Board
Reg. A/d Parivesh Bhawan, East Arjun Nagar, Shahdrara, New Delhi - 110 032

Cc: Rajasthan State Pollution Control Board
Reg. A/d 4, Institutional Area, Jhalana Dungri, Jaipur (Raj.) - 302 004

Cc: Regional Officer,
Reg. A/d Rajasthan State Pollution Control Board,
First Floor, Sehkar Bhoomi Vikas Bank Ltd., Nagaur- 341001



Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



ANNEXURE: 1

Test Report

Sample Number: VEL/JKW/A/01
Name & Address of the Party: M/s JK White Cement Works
(Unit of JK Cement LTD VIII. & PO-Gotan
Dist. Nagaur, Rajasthan)
Report No.: VEL/A/2203190005
Format No.: 7.8 F 01
Party Reference No.: NIL
Sample Description: Ambient Air Quality Monitoring
Report Date: 25/03/2022
Period of Analysis: 19/03/2022-25/03/2022
Receipt Date: 19/03/2022

General Information:-

Sampling Location : 132 KVSS
Sample collected by : VEL Team
Sampling Equipment used : RDS & FPS
Instrument Code : VEL/RDS/FPS/02/21
Instrument Calibration Status : Calibrated
Latitude : 26°38'50"
Longitude : 73°44'46"
Meteorological condition during monitoring : Clear sky
Date of Sampling : 12/03/2022 to 13/03/2022
Time of Sampling : 14:30 to 14:30 Hrs.
Ambient Temperature (°C) : Min. 22°C, Max. 37 °C
Surrounding Activity : Human & Vehicular Activities
Scope of Monitoring : Regulatory Requirement
Sampling & Analysis Protocol : IS-5182 & CPCB Guidelines
Sampling Duration : 24 hrs.
Parameter Required : As Per Work Order

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	39.36	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	76.48	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	19.75	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	9.12	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.56	mg/m ³	4
6.	Ammonia (NH ₃)	IS: 11255 (P-6), Reaffirmed-2009	7.78	µg/m ³	400
7.	Lead (Pb)	IS: 5182 (P-22), Reaffirmed-2009	0.20	µg/m ³	1
8.	Benzene (C ₆ H ₆)	IS: 5182 (P-11), 2004	BDL (DL 1.0)	µg/m ³	05
9.	Benzo(a)pyrene, (B(a)P)	IS: 5182 (P-12), 2004	BDL (DL 0.5)	ng/m ³	01
10.	Ozone (O ₃)	IS: 5182 (P-9), Reaffirmed-2003	14.86	µg/m ³	180
11.	Arsenic as (As)	IS: 5182 (P-22), Reaffirmed-2009	BDL (DL 1.0)	ng/m ³	6
12.	Nickel as (Ni)	IS: 5182 (P-22), Reaffirmed-2009	BDL (DL 5.0)	ng/m ³	20

Note :- *BDL-Below Detection Limit, **DL-Detection Limit.

(Checked By)

(Authorized Signatory)



www.vardan.co.in

Ph: 0124-4343750/752/753, 9810355569, 9953147268 E-mail: lab@vardan.co.in, bd@vardan.co.in



Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



Test Report

Sample Number: VEL/JKW/A/02
Name & Address of the Party: M/s JK White Cement Works
(Unit of JK Cement LTD Vill. & PO-Gotan
Dist. Nagaur, Rajasthan)
Report No.: VEL/A/2203190006
Format No.: 7.8 F 01
Party Reference No.: NIL
Report Date: 25/03/2022
Period of Analysis: 19/03/2022-25/03/2022
Receipt Date: 19/03/2022

Sample Description: Ambient Air Quality Monitoring

General Information:-

Sampling Location: Rest Shelter/Dolomite Ramp
Sample collected by: VEL Team
Sampling Equipment used: RDS & FPS
Instrument Code: VEL/RDS/FPS/26/15
Instrument Calibration Status: Calibrated
Latitude: 26°38'43"
Longitude: 73°44'32"
Meteorological condition during monitoring: Clear sky
Date of Sampling: 12/03/2022 to 13/03/2022
Time of Sampling: 14:50 to 14:50 Hrs.
Ambient Temperature (°C): Min. 22°C, Max. 37 °C
Surrounding Activity: Human, Vehicular Plant Activities
Scope of Monitoring: Regulatory Requirement
Sampling & Analysis Protocol: IS-5182 & CPCB Guidelines
Sampling Duration: 24 hrs.
Parameter Required: As Per Work Order

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	*SOP No. VEL/SOP/01, Section No. SP 63	42.61	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	80.56	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	22.94	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	12.86	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.67	mg/m ³	4
6.	Ammonia (NH ₃)	IS: 11255 (P-6), Reaffirmed-2009	1.14	µg/m ³	400
7.	Lead (Pb)	IS: 5182 (P-22), Reaffirmed-2009	0.24	µg/m ³	1
8.	Benzene (C ₆ H ₆)	IS: 5182 (P-11), 2004	BDL (DL 1.0)	µg/m ³	05
9.	Benzo(a)pyrene, (B(a)P)	IS: 5182 (P-12), 2004	BDL (DL 0.5)	ng/m ³	01
10.	Ozone (O ₃)	IS: 5182 (P-9), Reaffirmed-2003	14.16	µg/m ³	180
11.	Arsenic as (As)	IS: 5182 (P-22), Reaffirmed-2009	BDL (DL 1.0)	ng/m ³	6
12.	Nickel as (Ni)	IS: 5182 (P-22), Reaffirmed-2009	BDL (DL 5.0)	ng/m ³	20

Note :- *BDL-Below Detection Limit, **DL-Detection Limit.

(Checked By)

(Authorized Signatory)



www.vardan.co.in

Ph: 0124-4343750/752/753, 9810355569, 9953147268 E-mail: lab@vardan.co.in, bd@vardan.co.in



Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



Test Report

Sample Number: VEL/JKW/A/03
Name & Address of the Party: M/s JK White Cement Works
(Unit of JK Cement LTD Vill. & PO-Gotan
Dist. Nagaur, Rajasthan)
Sample Description: Ambient Air Quality Monitoring

Report No.: VEL/A/2203190007
Format No.: 7.8 F 01
Party Reference No.: NIL
Report Date: 25/03/2022
Period of Analysis: 19/03/2022-25/03/2022
Receipt Date: 19/03/2022

General Information:-

Sampling Location: EDP/Club Building
Sample collected by: VEL Team
Sampling Equipment used: RDS & FPS
Instrument Code: VEL/RDS/FPS/32/28
Instrument Calibration Status: Calibrated
Latitude: 26°38'30"
Longitude: 73°44'30"
Meteorological condition during monitoring: Clear sky
Date of Sampling: 12/03/2022 to 13/03/2022
Time of Sampling: 15:10 to 15:10 Hrs.
Ambient Temperature (°C): Min. 22°C, Max. 39 °C
Surrounding Activity: Human, Vehicular & Plant Activities
Scope of Monitoring: Regulatory Requirement
Sampling & Analysis Protocol: IS-5182 & CPCB Guidelines
Sampling Duration: 24 hrs.
Parameter Required: As Per Work Order

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	36.89	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	72.53	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	17.46	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	9.12	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.55	mg/m ³	4
6.	Ammonia (NH ₃)	IS: 11255 (P-6), Reaffirmed-2009	6.43	µg/m ³	400
7.	Lead (Pb)	IS: 5182 (P-22), Reaffirmed-2009	0.15	µg/m ³	1
8.	Benzene (C ₆ H ₆)	IS: 5182 (P-11), 2004	BDL (DL 1.0)	µg/m ³	05
9.	Benzo(a)pyrene, (B(a)P)	IS: 5182 (P-12), 2004	BDL (DL 0.5)	ng/m ³	01
10.	Ozone (O ₃)	IS: 5182 (P-9), Reaffirmed-2003	12.86	µg/m ³	180
11.	Arsenic as (As)	IS: 5182 (P-22), Reaffirmed-2009	BDL (DL 1.0)	ng/m ³	6
12.	Nickel as (Ni)	IS: 5182 (P-22), Reaffirmed-2009	BDL (DL 5.0)	ng/m ³	20

Note :- *BDL-Below Detection Limit, **DL-Detection Limit.

(Checked By)

(Authorized Signatory)



3

www.vardan.co.in

Ph: 0124-4343750/752/753, 9810355569, 9953147268 E-mail: lab@vardan.co.in, bd@vardan.co.in



Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



Test Report

Sample Number: VEL/JKW/A/04
Name & Address of the Party: M/s JK White Cement Works
(Unit of JK Cement LTD Vill. & PO-Gotan
Dist. Nagaur, Rajasthan)
Report No.: VEL/A/2203190008
Format No.: 7.8 F 01
Party Reference No.: NIL
Sample Description: Ambient Air Quality Monitoring
Report Date: 25/03/2022
Period of Analysis: 19/03/2022-25/03/2022
Receipt Date: 19/03/2022

General Information:-
Sampling Location : CS-11
Sample collected by : VEL Team
Sampling Equipment used : RDS & FPS
Instrument Code : VEL/RDS/FPS/24
Instrument Calibration Status : Calibrated
Latitude : 26°38'28"
Longitude : 73°44'46"
Meteorological condition during monitoring : Clear sky
Date of Sampling : 12/03/2022 to 13/03/2022
Time of Sampling : 15:00 to 15:00 Hrs.
Ambient Temperature (°C) : Min. 22°C, Max. 37 °C
Surrounding Activity : Human & Vehicular Activities
Scope of Monitoring : Regulatory Requirement
Sampling & Analysis Protocol : IS-5182 & CPCB Guidelines
Sampling Duration : 24 hrs.
Parameter Required : As Per Work Order

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	31.62	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	69.44	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	15.78	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	8.61	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.52	mg/m ³	4
6.	Ammonia (NH ₃)	IS: 11255(P-6), Reaffirmed-2009	5.78	µg/m ³	400
7.	Lead (Pb)	IS: 5182 (P-22), Reaffirmed-2009	0.09	µg/m ³	1
8.	Benzene(C ₆ H ₆)	IS: 5182 (P-11), 2004	BDL (DL 1.0)	µg/m ³	05
9.	Benzo(a)pyrene,(B(a)P)	IS: 5182 (P-12), 2004	BDL (DL 0.5)	ng/m ³	01
10.	Ozone (O ₃)	IS: 5182 (P-9), Reaffirmed-2003	10.56	µg/m ³	180
11.	Arsenic as (As)	IS: 5182 (P-22), Reaffirmed-2009	BDL (DL 1.0)	ng/ m ³	6
12.	Nickel as (Ni)	IS: 5182 (P-22), Reaffirmed-2009	BDL (DL 5.0)	ng/ m ³	20

Note :- *BDL-Below Detecation Limit, **DL-Detecation Limit.

(Checked By)

(Authorized Signatory)





Test Report

Sample Number:	VEL/JKW/AN/01	Report No.:	VEL/N/2203190005
Name & Address of the Party:	M/s JK White Cement Works (Unit of JK Cement LTD Vill. & PO-Gotan Dist. Nagaur, Rajasthan)	Format No.:	7.8 F 01
Sample Description:	Ambient Noise Level Monitoring	Party Reference No.:	NIL
Scope of Monitoring	Regulatory Requirement	Reporting Date:	25/03/2022
Protocol Used:	IS 9989: IS 9876	Receipt Date:	19/03/2022
Instrument Used	SLM	Sampling Duration	24 Hrs.
		Sample Collected by	VEL Team
		Instrument Calibration Status	Calibrated

General Information:-


Sampling Location	: 132 KVSS
Instrument Code	: VEL/SLM/01
Meteorological condition during monitoring	: Clear sky
Date of Monitoring	: 12/03/2022 to 13/03/2022
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min. 22°C, Max. 37 °C
Surrounding Activity	: Human & Vehicular Activities
Parameter Required	: As per Work Order

Sr.No.	Test Parameter	Protocol	Test Result dB(A)	
			Day Time	Night Time
1.	Leq	IS:9989,IS9876:1981	64.36	53.95

Category of Zones	Leq in dB (A)	
	Day	Night
Industrial	75	70
Commercial	65	55
Residential	55	45
Silence Zone	50	40

1. Day Time is from 6.00 AM to 10.00 PM.
2. Night Time is reckoned between 10.00 PM to 6.00 AM.
3. Silence Zone is defined as an area up to 100 m around premises of Hospitals, Educational and Courts. Use of vehicle horn, Loudspeaker and bursting of crackers is banned in these zones.

Note: Mixed categories of areas be declared as one of the four above mentioned categories by the competent Authority and the corresponding standards shall apply


(Checked By)


(Authorized Signatory)





Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



Test Report

Sample Number:	VEL/JKW/AN/02	Report No.:	VEL/N/2203190006
Name & Address of the Party:	M/s JK White Cement Works (Unit of JK Cement LTD Vill. & PO-Gotan Dist. Nagaur, Rajasthan)	Format No.:	7.8 F 01
Sample Description:	Ambient Noise Level Monitoring	Party Reference No.:	NIL
Scope of Monitoring	Regulatory Requirement	Reporting Date:	25/03/2022
Protocol Used:	IS 9989: IS 9876	Receipt Date:	19/03/2022
Instrument Used	SLM	Sampling Duration	24 Hrs.
		Sample Collected by	VEL Team
		Instrument Calibration Status	Calibrated

General Information:-

Sampling Location	: Rest shelter/Dolomite Ramp
Instrument Code	: VEL/SLM/02
Meteorological condition during monitoring	: Clear sky
Date of Monitoring	: 12/03/2022 to 13/03/2022
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min. 22°C, Max. 37 °C
Surrounding Activity	: Human & Vehicular Activities
Parameter Required	: As per Work Order

Sr.No.	Test Parameter	Protocol	Test Result dB(A)	
			Day Time	Night Time
1.	Leq	IS:9989,IS9876:1981	68.14	59.62

Category of Zones	Leq in dB (A)	
	Day	Night
Industrial	75	70
Commercial	65	55
Residential	55	45
Silence Zone	50	40

1. Day Time is from 6.00 AM to 10.00 PM.
2. Night Time is reckoned between 10.00 PM to 6.00 AM.
3. Silence Zone is defined as an area up to 100 m around premises of Hospitals, Educational and Courts. Use of vehicle horn, Loudspeaker and bursting of crackers is banned in these zones.
Note: Mixed categories of areas be declared as one of the four above mentioned categories by the competent Authority and the corresponding standards shall apply

(Checked By)

(Authorized Signatory)





Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



Test Report

Sample Number:	VEL/JKW/AN/03	Report No.:	VEL/N/2203190007
Name & Address of the Party:	M/s JK White Cement Works (Unit of JK Cement LTD Vill. & PO-Gotan Dist. Nagaur, Rajasthan)	Format No.:	7.8 F 01
Sample Description:	Ambient Noise Level Monitoring	Party Reference No.:	NIL
Scope of Monitoring:	Regulatory Requirement	Reporting Date:	25/03/2022
Protocol Used:	IS 9989: IS 9876	Receipt Date:	19/03/2022
Instrument Used:	SLM	Sampling Duration:	24 Hrs.
		Sample Collected by:	VEL Team
		Instrument Calibration Status:	Calibrated

General Information:-

Sampling Location	: CS-11
Instrument Code	: VEL/SLM/03
Meteorological condition during monitoring	: Clear sky
Date of Monitoring	: 12/03/2022 to 13/03/2022
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min. 22°C, Max. 37 °C
Surrounding Activity	: Human & Vehicular Activities
Parameter Required	: As per Work Order

Sr.No.	Test Parameter	Protocol	Test Result dB(A)	
			Day Time	Night Time
1.	Leq	IS:9989,IS9876:1981	54.67	44.53

Category of Zones	Leq in dB (A)	
	Day	Night
Industrial	75	70
Commercial	65	55
Residential	55	45
Silence Zone	50	40

- Day Time is from 6.00 AM to 10.00 PM.
 - Night Time is reckoned between 10.00 PM to 6.00 AM.
 - Silence Zone is defined as an area up to 100 m around premises of Hospitals, Educational and Courts. Use of vehicle horn, Loudspeaker and bursting of crackers is banned in these zones.
- Note: Mixed categories of areas be declared as one of the four above mentioned categories by the competent Authority and the corresponding standards shall apply

(Checked By)

(Authorized Signatory)



www.vardan.co.in

Ph: 0124-4343750/752/753, 9810355569, 9953147268 E-mail: lab@vardan.co.in, bd@vardan.co.in



Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



Test Report

Sample Number:	VEL/JK/AN/04	Report No.:	VEL/N/2203190008
Name & Address of the Party:	M/s JK White Cement Works (Unit of JK Cement LTD Vill. & PO-Gotan Dist. Nagaur, Rajasthan)	Format No.:	7.8 F 01
Sample Description:	Ambient Noise Level Monitoring	Party Reference No.:	NIL
Scope of Monitoring:	Regulatory Requirement	Reporting Date:	25/03/2022
Protocol Used:	IS 9989: IS 9876	Receipt Date:	19/03/2022
Instrument Used:	SLM	Sampling Duration:	24 Hrs.
		Sample Collected by:	VEL Team
		Instrument Calibration Status:	Calibrated

General Information:-

Sampling Location	: EDP / Club Building
Instrument Code	: VEL/SLM/04
Meteorological condition during monitoring	: Clear sky
Date of Monitoring	: 12/03/2022 to 13/03/2022
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min. 22°C, Max. 39 °C
Surrounding Activity	: Human & Vehicular Activities
Parameter Required	: As per Work Order

Sr.No.	Test Parameter	Protocol	Test Result dB(A)	
			Day Time	Night Time
1.	Leq	IS:9989,IS9876:1981	54.95	44.68

Category of Zones	Leq in dB (A)	
	Day	Night
Industrial	75	70
Commercial	65	55
Residential	55	45
Silence Zone	50	40

1. Day Time is from 6.00 AM to 10.00 PM.
2. Night Time is reckoned between 10.00 PM to 6.00 AM.
3. Silence Zone is defined as an area up to 100 m around premises of Hospitals, Educational and Courts. Use of vehicle horn, Loudspeaker and bursting of crackers is banned in these zones.
Note: Mixed categories of areas be declared as one of the four above mentioned categories by the competent Authority and the corresponding standards shall apply

(Checked By)

(Authorized Signatory)



8

www.vardan.co.in

Ph: 0124-4343750/752/753, 9810355569, 9953147268 E-mail: lab@vardan.co.in, bd@vardan.co.in



Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



Test Report

Sample Number: VEL/JKW/S/21
Name & Address of Party: M/s JK White Cement Works
(Unit of JK Cement LTD Vill. & PO-Gotan
Dist. Nagaur, Rajasthan
Report No.: VEL/S/2203190021
Format No.: 5.10 F-01
Party Reference No.: NIL
Reporting Date: 25/03/2022
Period of Analysis: 19/03/2022

Receipt Date: 19/03/2022

Sample Description : STACK EMISSION MONITORING

Sample Collected : Vardan EnviroLab Team
Date & Time of Sampling : 14/03/2022 (16:38 to 17:34)
Sampling Location : Boiler ESP Stack (TPP)
Stack Attached : ESP
Sampling duration (Minutes) : 56
Make Of Stack : MS
Meteorological Condition : Clear Sky
Stack Diameter : 1.2 m
Stack Height : 72.0 m
Instrument calibration status : Calibrated
Ambient Temperature - Ta (°C) : 39
Temperature of Stack Gases - Ts (°C) : 91
Velocity of Stack Gases (m/sec.) : 5.28
Flow rate of PM (LPM) : 18
Flow rate of Gas (LPM) : NA
Sampling method : OK
Protocol used : IS-11255 & CPCB Guidelines

RESULTS

S. No.	Parameter	Protocol	Results	Units	Limits
1.	Particulate Matter as (PM)	IS 11255 (P-1) Gravimetric Method, RA:2003	22.86	mg/Nm3	50
2.	Oxide of nitrogen as (NOX)	IS 11255 (P-7) Colorimetric Method, RA:2012	130.75	mg/Nm3	300
3.	Sulphur Dioxide as (SO2)	IS 11255 (P-2) Titrimetric Method, RA:2003	362.82	mg/Nm3	600
4.	Carbon Monoxide as (CO)	By CO Analyzer	44.66	mg/Nm3	NS
5.	Total Mercury	US EPA Method No. 29	BDL (DL 0.005)	mg/Nm3	0.03

ANJU INDOLIA
Sr. Analyst

(Checked By)



VEL/E/1/TR/PN36941



(Authorized Signatory)

25/03/2022 www.vardan.co.in

Ph: 0124-4343750/752/753, 9810355569, 9953147268 E-mail: lab@vardan.co.in, bd@vardan.co.in



Vardan EnviroLab

Laboratory: Plot No. 82A, Sector - 5, IMT Manesar, Gurugram - 122051 (Haryana)
ISO 9001 | ISO 14001 | ISO 45001



Test Report

Sample Number:
Name & Address of Party:

VEL /JKW/WW/02
M/s JK White Cement Works
(Unit of JK Cement LTD Vill. & PO-Gotan
Dist. Nagaur, Rajasthan

Report No.:
Format No.:
Party Reference No.:
Reporting Date:

VEL/WW/2203190003
7.8 F 01
NIL
25/03/2022

Sample Description:
Sampling Location:
Sample Collected by
Preservation:
Sampling & Analysis Protocol:

Waste Water
Neutralization Pit TPP
Vardan EnviroLab
Refrigerated
IS-3025

Period of Analysis:
Receipt Date:
Sampling Date:
Sampling Type:
Sample Quantity:

19-03-2022 to 25-03-2022
19/03/2022
15/03/2022
Grab
2.0 Ltr.

TEST RESULTS

S.No.	Test Parameters	Test Method	Result	Unit	Prescribed Limit
1	pH	IS 3025 (P-11): 1983 Reaff. 2017	7.38	-	6.5 - 8.5
2	Total Suspended Solids	IS: 3025 (Part 17): 1984, Reaff. 2017	32.6	mg/l	100.0
3	Temperature	IS-3025 (Part-9): 1984, Ref: 2017	26.4	°C	Shall not exceed 5°C above the receiving water temperature
4	Oil & Grease	IS 3025(P-39):1991 RA 2019	1.2	mg/l	10.0
5	BOD (3 days @ 27°C)	IS: 3025 (Part-44): 1993, Ref: 2019	14.0	mg/l	30.0
6	COD	IS : 3025 (Part 58) : 2006 Ref: 2017	69.2	mg/l	250.0
7	Chromium (as Cr)	APHA 23rd Edition Year 2017 Method No. 3113 B	0.06	mg/l	0.2
8	Copper (as Cu)	APHA 23rd Edition 2017 Method No. 3111 APHA 23rd Edition 2017 Method No. 3111B	0.18	mg/l	1.0
9	Zinc (as Zn)	APHA (23rd edition-2017), 3030D, 3113 B	0.32	mg/l	1.0
10	Phosphate (as PO4)	APHA 4500 PC:2017	0.66	mg/l	5.0
11	Residual Free Chlorine	APHA 3500 Cl B Iodometric Method:2017	*BDL(**D L-0.2)	mg/l	0.5
12	Iron (as Fe)	IS 3025(P-53): 2003 Reaffirm 2019	0.27	mg/l	1.0


(Checked By)

(Authorized Signatory)



274139

GATE

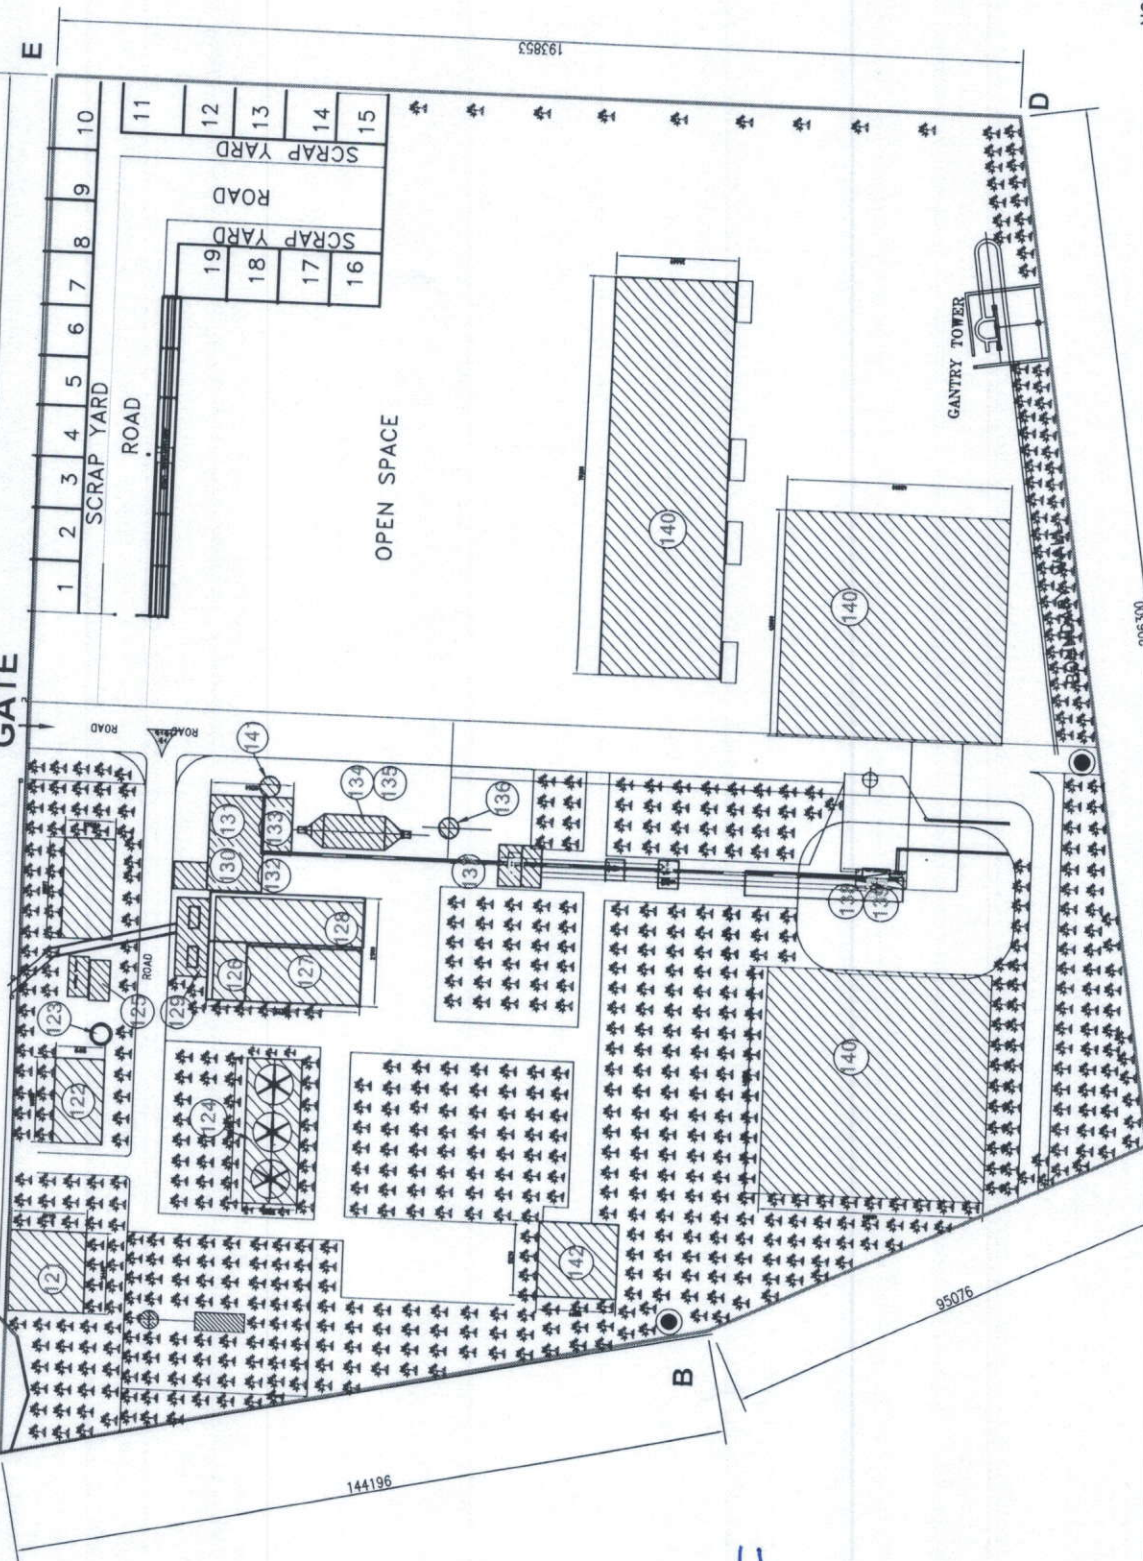

142.	TPP OFFICE
141.	ASH SILO(TPP)
140.	FUEL STORAGE YARD(TPP)
139.	GREZZALY HOPPER(TPP)
138.	CRUSHER HOUSE(TPP)
137.	CONVEYOR(TPP)
136.	CHIMNEY (TPP)
135.	ID FAN(TPP)
134.	ESP(TPP)
133.	FD FAN(TPP)
132.	PA FAN(TPP)
131.	BUNKER(TPP)
130.	BOILER(TPP)
129.	TRANSFORMER YARD(TPP)
128.	DEAERATOR CUM STORAGE TANK(TPP)
127.	CONTROL ROOM(TPP)
126.	TG HOUSE(TPP)
125.	AUXILIARY TOWER (TPP)
124.	AIR COOLED CONDENSOR (TPP)
123.	DM STORAGE TANK (TPP)
122.	WATER TREATMENT PLANT (TPP)
121.	RAW WATER STORAGE TANK (TPP)
S.NO.	INDEX



ANNEXURE:2

NOTES-

1. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
2. DONOT SCALE THE DIMENSIONS. IN CASE OF DOUBT, PLEASE ASK.

J.K.WHITE CEMENT WORKS,GOTAN		REV. NO.-	177-25/84
DATE	18-08-14	REV. NO.-	177-25/84
CHECKED BY	P.S.VISHVA	REV. NO.-	177-25/84
APPROVED		REV. NO.-	177-25/84
SCALE	1:500	REV. NO.-	177-25/84
ACAD FILE-		REV. NO.-	177-25/84

AREA = 50000 sqm
 = 5000000 sqft
 = 32.4 Acre
 = 5.25 Hect
 = 12.97 Acres

EXISTING PLANT



REV. NO.	DATE	DESCRIPTION	DEN.	CHD.

DRWN	ARADHYA S.	TITLE	THermal POWER PLANT PLANTATION LAYOUT
------	------------	-------	---------------------------------------

DATE	18-08-14
CHECKED BY	P.S.VISHVA
APPROVED	
SCALE	1:500
ACAD FILE-	

DRWN	ARADHYA S.	TITLE	THermal POWER PLANT PLANTATION LAYOUT
------	------------	-------	---------------------------------------

DATE	18-08-14
CHECKED BY	P.S.VISHVA
APPROVED	
SCALE	1:500
ACAD FILE-	

DRWN	ARADHYA S.	TITLE	THermal POWER PLANT PLANTATION LAYOUT
------	------------	-------	---------------------------------------

ANNEXURE: 3

M/s JK White Cement Works, Gotan													
2021-22													
PLANT	ID	EMPL. NAM	DV/L	DV/R	NV/L	NV/R	HT (IN CMS)	WT (IN KG)	B/G	ECG	CARDIAC MONITORING	AUDIOMETRY	SPIROMETRY
JKWC	A0160	ARUN KUMAR CHATURVEDI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	158	56.5	O+VE	NORMAL			
JKWC	A0220	AMRA RAM	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	165	56	B+VE	NORMAL		ML BE	NORMAL
JKWC	A0640	AJAY GARG	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	178	71	B+VE	NORMAL		ML BE	NORMAL
JKWC	A0990	ASHUTOSH BHARDWAJ	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	94.7	B+VE	NORMAL		NORMAL	NORMAL
JKWC	A1010	ARVIND PUROHIT	6/6	6/6	N-6	N-6	182	70	A+VE	NORMAL		NORMAL	NORMAL
JKWC	A1020	ARADHYA SHARMA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	167	75	O+VE	NORMAL		NORMAL	NORMAL
JKWC	A1080	ABDUL KHAN	6/9	6/9	N-8 C GLS	N-8 C GLS	165	77	A+VE	NORMAL		NORMAL	NORMAL
JKWC	A1150	ANKIT RANA	6/6	6/6	N-6	N-6	176	91	B+VE	NORMAL		ML BE	NORMAL
JKWC	A1260	AJAY KUMAR	6/6 C GLS	6/6 C GLS	N-6	N-6	182	75	B+VE	NORMAL		NOMAL	NORMAL
JKWC	A1270	ANSHU SHARMA	6/9	6/9	N-6	N-6	167	73.4	O+VE	NORMAL		NORMAL	NORMAL
JKWC	A1290	ANIL KUMAR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	82	B+VE	NORMAL		ML LE	NORMAL
JKWC	A1310	AMIT KUMAR SHARMA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	171	70	A+VE	NORMAL		ML LE	NORMAL
JKWC	A1350	ABHISHEK JOSHI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	182	82	O+VE	NORMAL		NORMAL	NORMAL
JKWC	A1370	AKASH VERMA	6/6	6/6	N-6	N-6	167	57.7	B+VE	NORMAL		ML BE	MILD REST
JKWC	A1470	ASLAM KHAN	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	177	76	AB+VE	NORMAL		NORMAL	NORMAL
JKWC	A1500	ASHUTOSH UPADHYAY	6/6	6/6	N-6	N-6	169.5	76	AB+VE	NORMAL		ML RE	MILD REST
JKWC	A1520	ASHUTOSH SHRIVASTAVA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	166	76	B+VE	NORMAL		NORMAL	NORMAL
JKWC	A1530	AMAN JOSHI	6/6	6/6	N-6	N-6	176	74	B+VE	NORMAL		NORMAL	NORMAL
JKWC	A1550	AJIT MISHRA	6/6	6/6	N-6	N-6	185	99	O+VE	NORMAL		NORMAL	NORMAL
JKWC	A1560	AMIT KUMAR PAREEK	6/6	6/6	N-6	N-6	173	75	A+VE	NORMAL		NORMAL	MILD REST
JKWC	A1600	ANIL GUPTA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	168.5	90	O+VE	NORMAL		NORMAL	NORMAL
JKWC	A1610	ANKIT NAVAL	6/6	6/6	N-6	N-6	172	68	A+VE	NORMAL		NORMAL	NORMAL
JKWC	A1630	APEKSHA PANDEY	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	160	67	A+VE	NORMAL		NORMAL	NORMAL
JKWC	A1640	ARUN KUMAR	6/9	6/9	N-6 C GLS	N-6 C GLS	167	84	O+VE	NORMAL		NORMAL	NORMAL
JKWC	A1650	ARUN KUMAR SAXENA	6/6	6/6	N-8 C GLS	N-8 C GLS	169	76.6	O+VE	NORMAL		NORMAL	NORMAL
JKWC	A1660	AKSHAY NIGAM	6/6	6/6	N-6	N-6	175	93.5	B+VE	NORMAL		ML BE	NORMAL
JKWC	B0140	BHANWAR LAL	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	160	68	AB+VE	NORMAL		NORMAL	NORMAL
JKWC	B0240	BRIJ KISHORE KANAUJIYA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	173	89.9	B+VE	NORMAL		ML LE	NORMAL
JKWC	B0280	B P GUPTA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	162	68	B+VE	NORMAL		ML BE	MILD REST
JKWC	B0300	BHANWAR SINGH	6/6	6/6	N-6 C GLS	N-6 C GLS	170	82	O+VE	NORMAL		ML BE	NORMAL
JKWC	B0600	BHAWANI SINGH RATHORE	6/6	6/6	N-6	N-6	169	92	O+VE	NORMAL		ML RE	NORMAL
JKWC	B0680	BRIJ GOPAL SEWAG	6/6	6/6	N-6	N-6	179	119	A+VE	NORMAL		NORMAL	NORMAL
JKWC	B0790	BRIJESH CHOUDHARY	6/6	6/6	N-6	N-6	173.5	83	O+VE	NORMAL		NORMAL	NORMAL
JKWC	B0800	BIRMA RAM	6/6	6/6	N-6	N-6	159	49	B+VE	NORMAL		NORMAL	NORMAL
JKWC	B0820	BABU LAL	6/6	6/6	N-6	N-6	167	69	A+VE	NORMAL		ML BE	NORMAL
JKWC	B0860	BIRA SINGH	6/9	6/9	N-6	N-6	170	80.7	B+VE	NORMAL		NORMAL	NORMAL
JKWC	B0870	BUDH SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	171	74	O+VE	NORMAL		ML BE	NORMAL
JKWC	B0920	BHARAT KUMAR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	166	64.5	B+VE	NORMAL		ML BE	NORMAL
JKWC	B0940	BABU KHAN	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	170.5	85	O+VE	NORMAL		NORMAL	NORMAL
JKWC	B0960	BHASKAR MEHTA	6/6	6/6	N-6	N-6	162	66.6	A+VE	NORMAL		NORMAL	NORMAL
JKWC	C0150	CHAILA RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	163	61.5	AB+VE	NORMAL		ML BE	MILD REST
JKWC	D0180	DEVA RAM	6/6	6/6	N-6	N-6	164	69.5	O+VE	NORMAL		ML BE	NORMAL
JKWC	D0200	DAULAT SINGH NATHAWAT	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	85.5	O+VE	NORMAL		ML BE	MILD REST
JKWC	D0390	DANA RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	170	57.4	B+VE	NORMAL		NORMAL	NORMAL
JKWC	D0640	DEEPAK KHABYA	6/6	6/6	N-6	N-6	175	51.8	B+VE	NORMAL		NORMAL	MILD REST
JKWC	D0650	DILIP KUMAR	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	163	70	B+VE	NORMAL		ML LE	NORMAL
JKWC	D0710	DILIP SHARMA	6/6	6/6	N-6	N-6	160	60.4	AB+VE	NORMAL		NORMAL	NORMAL
JKWC	D0740	DALPAT RAM PARIHAR	6/6	6/6	N-6	N-6	167	73.6	O+VE	NORMAL		ML LE	NORMAL
JKWC	D0760	DHARMENDRA DUTTA PUROHIT	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	192	102	A+VE	NORMAL		ML BE	NORMAL
JKWC	D0790	DESH RAJ	6/9	6/9	N-6	N-6	168	82	A+VE	NORMAL		ML BE	MILD REST
JKWC	D0810	DHANNA RAM	NIL	6/6 C GLS	NIL	N-6 C GLS	164	66	B+VE	NORMAL		ML BE	MILD REST
JKWC	D0830	DHANRAJ CHOUDHARY	6/6	6/6	N-6	N-6	173.5	77	O+VE	NORMAL		NORMAL	NORMAL
JKWC	D0870	DEEP KISHORE SARASWAT	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	172	86.9	O+VE	NORMAL		NORMAL	NORMAL
JKWC	D0880	DEEPAK KUMAR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	172	86.5	AB+VE	NORMAL		NORMAL	NORMAL
JKWC	D0890	DEEPAK BABBAR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	179	89.5	B+VE	NORMAL		NORMAL	NORMAL
JKWC	F0040	FATEH SINGH RATHORE	6/6	6/6	N-6	N-6	177	68.6	O+VE	NORMAL		NORMAL	NORMAL
JKWC	G0050	GHANSHYAM SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	170	73	A+VE	NORMAL		NORMAL	NORMAL
JKWC	G0090	GOPAL LAL GAUR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	165	66.5	O+VE	NORMAL		ML BE	NORMAL
JKWC	G0120	GAURDHAN SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	171	62.6	O+VE	NORMAL		NORMAL	NORMAL
JKWC	G0140	GOPA RAM	6/6	6/6	N-6	N-6	173	77	O+VE	NORMAL		ML BE	NORMAL
JKWC	G0230	GOUTAM RATAWA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	161	51.6	B+VE	NORMAL		NORMAL	NORMAL
JKWC	G0290	GUMAN SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	168.5	63	A+VE	NORMAL		ML RE	NORMAL
JKWC	G0350	GIRJESH KUMAR AGRAWAT	6/6	6/6	N-6	N-6	176	87.7	O+VE	NORMAL		ML BE	MILD REST
JKWC	G0430	GAJENDRA PANWAR	6/6	6/6	N-6	N-6	167	65.5	B+VE	NORMAL		NORMAL	NORMAL
JKWC	G0480	GAURAV SHARMA	6/6	6/6	N-6	N-6	170	68	AB+VE	NORMAL		NORMAL	NORMAL
JKWC	G0500	GAURAV	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	172	79	O+VE	NORMAL		NORMAL	NORMAL
JKWC	H0180	HEER SINGH SHEKHAWAT	6/6	6/6	N-6	N-6	170	81.5	A+VE	NORMAL		NORMAL	NORMAL
JKWC	H0190	HEMANT SHARMA	6/6	6/6	N-6	N-6	176	73	A+VE	NORMAL		ML LE	MILD REST
JKWC	H0320	HITESH GUPTA	6/6	6/6	N-6	N-6	165	67.2	O+VE	NORMAL		NORMAL	NORMAL
JKWC	H0350	HARISH CHANDRA PRAJAPATI	6/6	6/6	N-6	N-6	174.5	74	A+VE	NORMAL		ML BE	MILD REST
JKWC	H0380	HARENDRA SHARMA	6/6	6/6	N-6	N-6	163	108	B+VE	NORMAL		NORMAL	NORMAL
JKWC	I0050	IMRAN NAZIR KHAN	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	162	67.7	O+VE	NORMAL		NORMAL	NORMAL
JKWC	J0030	J.P. RAJ	6/6	6/6	N-6	N-6	166	64.7	O+VE	NORMAL		NORMAL	NORMAL
JKWC	J0070	JOGI RAM	6/6	6/6	N-6	N-6	162	56	AB+VE	NORMAL		NORMAL	NORMAL
JKWC	J0220	JITENDRA SINGH SHEKHAWAT	6/6	6/6	N-6	N-6	176	88	B+VE	NORMAL		ML BE	NORMAL
JKWC	J0250	JAI PRAKASH OJHA	6/6	6/6	N-6	N-6	165	64.7	O+VE	NORMAL		ML BE	NORMAL
JKWC	J0300	JASSA RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	166	72	A+VE	NORMAL		NORMAL	MILD REST
JKWC	J0310	JAYANT SINGH SHEKHAWAT	6/6	6/6	N-6	N-6	168	70	A+VE	NORMAL		ML RE	MILD REST
JKWC	J0320	JAGDISH CHANDRA PRAJAPATI	6/6	6/6	N-6	N-6	180	80	O+VE	NORMAL		ML BE	NORMAL
JKWC	J0360	JAGDISH NAI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	68	O+VE	NORMAL		NORMAL	NORMAL
JKWC	J0390	JAY PRAKASH	6/6	6/6	N-6	N-6	172	77	B+VE	NORMAL		NORMAL	NORMAL
JKWC	K0080	KASTUR RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	169	88.4	A+VE	NORMAL		NORMAL	NORMAL
JKWC	K0130	KANA RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	162	73	A+VE	NORMAL		ML LE	NORMAL
JKWC	K0150	KISHAN LAL	6/6	6/6	N-6	N-6	164	60.7	O+VE	NORMAL		NORMAL	NORMAL
JKWC	K0160	KRISHAN MURARI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	72.5	O+VE	NORMAL		ML BE	MILD REST
JKWC	K0330	KHETA RAM	6/6	6/6	N-6 C GLS	N-6 C GLS	169	88	B+VE	NORMAL		ML BE	MILD REST
JKWC	K0370	KULDEEP SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	163	56	O+VE	NORMAL		ML LE	NORMAL
JKWC	K0600	KESHA RAM	6/6	6/6	N-6	N-6	184	108	O+VE	NORMAL		NORMAL	MILD REST
JKWC	K0620	KAILASH NATH	6/9	6/9	N-6	N-6	179	58	O+VE	NORMAL		NORMAL	MILD REST
JKWC	K0630	KESHA RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	158	45.5	B+VE	NORMAL			

JKWC	K0850	KANA RAM	6/6	6/6	N-6	N-6	175	54.5	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0010	L.N.SAIN	6/9 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	54.5	O-VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0070	LAXMAN SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	74.5	O-VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0180	LAL SINGH	6/6	6/6	N-6 C GLS	N-6 C GLS	175	82	AB+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0260	LOKESH VERMA	6/6	6/6	N-6 C GLS	N-6 C GLS	175	70	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0270	LAXMAN SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	81.5	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0280	LAXMAN SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	182	52	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0300	LALIT GARG	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	174	52	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0320	LOKESH	6/6	6/6	N-6	N-6	162	57.4	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0330	LIVANJALI DATA	6/6	6/6	N-6	N-6	176.5	76	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	L0340	LAXMAN SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	177	89	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M0020	M.C.SIKHWAL	6/6	6/6	N-6	N-6	150	54.5	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M0160	MOHAN SINGH	6/6	6/6	N-6	N-6	180.5	89	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M0240	MADAN LAL	6/9 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	83.5	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M0400	MATA DEEN	6/6 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	168	66.9	AB+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M0550	MANOJ KUMAR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	176	68	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M0740	MOINUDDIN RANGREJ	6/6	6/6	N-6 C GLS	N-6 C GLS	154	70	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M0880	MUKESH MATHUR	6/6	6/6	N-6	N-6	169	78.7	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M0920	MAHESH KUMAR BHAMBI	6/6	6/6	N-6	N-6	176.5	86.5	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M1020	MANISH TODWAL	6/6	6/6	N-6	N-6	180	55	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M1050	MANISH PRAJAPAT	6/6	6/6	N-6	N-6	160.5	62.8	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M1090	MEHRA RAM	6/6	6/6	N-6	N-6	166	77.5	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M1100	MANGI LAL KARWASRA	6/9	6/9	N-6 C GLS	N-6 C GLS	170	68	AB+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M1230	MANMOHAN SINGH RATHOR	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	158	70.5	AB+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M1240	MUKESH KATHAT	6/6	6/6	N-6	N-6	162	57	AB+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M1250	MAHESH KUMAR	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	168.5	61	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	M1270	MAHENDRA PRAJAPATI	6/6	6/6	N-6	N-6	174.5	89	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0030	N.L.THANVI	6/6	6/6	N-6	N-6	170.5	65.5	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0130	NARENDRA SINGH NEGI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	176	66.7	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0170	N.L.SHARMA	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	172	94	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0400	NAINA RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	174	85.8	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0420	NIRBHAY VERMA	6/6	6/6	N-6 C GLS	N-6 C GLS	177	67	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0430	NEERAJ KUMAR KARAN	6/6	6/6	N-6	N-6	166	75.9	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0460	NARENDRA SUTHAR	6/6	6/6	N-6	N-6	167	76	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0470	NITESH GUPTA	6/6	6/6	N-6	N-6	164	67	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0480	NARESH KUMAR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	172	51	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	N0490	NIMESH MODI	6/6	6/6	N-6	N-6	161	60	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	O0010	O.P.DADHICH	6/6	6/6	N-6	N-6	172.5	63.8	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	O0050	OM PRAKASH	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	172	82	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	O0060	OM PRAKASH JOSHI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	174	80	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	O0120	OM PRAKASH GURJAR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	172	65	AB+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	O0170	OM PRAKASH S/O SURJA RAM	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	173	69.5	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	O0180	O.N.PANDEY	6/9	6/9	N-6	N-6	174	73.7	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0030	P.K.SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	165	63	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0040	P.K.TRIPATHI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	168	78.3	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0170	POONAM CHAND	6/9	6/9	N-6 C GLS	N-6 C GLS	175	79	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0310	POKAR RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	170	65	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0500	PRAVIN KUMAR SHARMA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	164	55	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0680	PAWAN KUMAR	6/9	6/9	N-6 C GLS	N-6 C GLS	162	74	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0770	PRAKASH GUJAR	6/6	6/6	N-6 C GLS	N-6 C GLS	172	86	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0870	PUSHPENDRA SINGH CHOUHAN	6/6	6/6	N-6	N-6	173	64.4	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0880	PIYUSH SONI	6/6	6/6	N-6	N-6	170	88	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0890	PRAHLAD SHARMA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	180	86.8	O-VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0930	PRAVEEN SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	179	73.6	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P0970	PEEYUSH SHARMA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	159	67.5	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P1010	PRADEEP GOSWAMI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	163	77	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P1020	PURUSHOTTAM SHUKLA	6/6	6/6	N-6 C GLS	N-6 C GLS	169.5	66.6	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P1030	PREM SINGH SHEKHAWAT	6/6	6/6	N-6	N-6	181	100	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P1040	PRATHVI RAJ PUROHIT	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	166	71.5	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	P1050	PRITI SURESH PILLAY	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	173	59	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0170	RAJENDRA CHAUDHARY	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	154	84.5	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0260	RAM KARAN SHARMA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	174	75	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0310	RAM PRAKASH	6/6 C GLS	6/6 C GLS	N-6	N-6	177	92	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0430	RAM NIWAS	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	170	76	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0460	RAM DEV VYAS	6/6	6/6	N-6	N-6	165	83.5	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0480	RAM NIWAS	6/6	6/6	N-6 C GLS	N-6 C GLS	166	67	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0490	RAM PARSAD	6/6	6/6	N-6	N-6	172	83	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0500	RAMCHANDRA	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	167	64.5	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0720	RAJESH MAURYA	6/6	6/6	N-6 C GLS	N-6 C GLS	170	63	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R0900	RAM LAL	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	170	57.9	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R1150	RAJESH MATHUR	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	169	68	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R1310	RAHUL JAIN	6/6	6/6	N-6 C GLS	N-6 C GLS	158	62	AB+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R1800	RAM NIWAS SANGWA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	185	92	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R1810	RAM NIWAS JALWANIA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	177	80	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R1820	RAM CHANDRA KARWASRA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	176	79	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R1850	RAM SINGH	6/6	6/6	N-6 C GLS	N-6 C GLS	177	89	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R1940	RAHUL SAIN	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	176	71	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R1960	RADHEY SHYAM	6/6	6/6	N-6	N-6	179.5	91	A+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R2070	RAHUL GUPTA	6/6	6/6	N-6	N-6	162.5	69	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R2080	ROHIT KUMAR SHARMA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	168	65	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R2090	RAKESH KUMAR MADAN	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	164	71	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R2100	RAHUL BHAMBHI	6/6 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	182	87	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R2120	RAHUL YADAV	6/6	6/6	N-6	N-6	167	51	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R2130	RAHUL	6/6	6/6	N-6	N-6	173	66	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R2140	RADHEY SHYAM VYAS	6/9 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	173	82	AB+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	R2160	RAJESH KUMAR SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	171	64	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	S0020	S.C.SHARMA	6/6	6/6	N-6	N-6	167	79.8	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	S0040	S.K.JHA	6/6	6/6	N-6 C GLS	N-6 C GLS	172	84.5	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	S0080	S.N.PANDEY	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	177	97	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	S0140	SATISH KUMAR	6/6	6/6	N-6 C GLS	N-6 C GLS	179	69.8	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	S0200	SUBHASH CHAND	6/6	6/6	N-6 C GLS	N-6 C GLS	173	68.8	B+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	S0360	SAYAR RAM	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	163	61	O+VE	-----	NORMAL	-----	NORMAL	-----	NORMAL	-----
JKWC	S0410	SATYENDRA KUMAR PANDEY	6/6 C													

JKWC	S2640	SUGNA RAM	6/9 C GLS	6/9 C GLS	N-6 C GLS	N-6 C GLS	179	79	O+VE	NORMAL	-----	NORMAL	NORMAL
JKWC	S2650	SHYAM SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	173	75	O+VE	NORMAL	-----	NORMAL	NORMAL
JKWC	S2750	SHISHPAL CHOUDHARY	6/6	6/6	N-6	N-6	169	73.5	A+VE	-----	NORMAL	ML BE	NORMAL
JKWC	S2790	SHRI RAM SHARMA	6/6	6/6	N-8	N-8	176	79	A+VE	NORMAL	-----	NORMAL	NORMAL
JKWC	S2810	SUMIT ARORA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	167	78.5	B+VE	-----	NORMAL	ML LE	NORMAL
JKWC	S2850	SURYAPRAKASH CHOUDHARY	6/6	6/6	N-6	N-6	182	79	O+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	S2860	SHAFIK ALI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	166	77.5	B+VE	-----	NORMAL	ML LE	NORMAL
JKWC	S2870	SAROJ KUMAR SINGH	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	164.5	68.7	A+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	S3010	SATYANDRA SINGH SONAGARA	6/6	6/6	N-6	N-6	184	72	B+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	S3030	SUSHIL KUMAR TAK	6/6	6/6	N-6	N-6	171	72	A+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	S3080	SHIVAM PAREEK	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	168	54.5	B+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	S3090	SATYENDRA KUMAR MALAV	6/6	6/6	N-6	N-6	172	65	B+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	S3100	SACHIN GUPTA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	176	77	O+VE	-----	NORMAL	ML LE	NORMAL
JKWC	S3120	SARDARA RAM CHOUDHARY	6/6	6/6	N-6	N-6	174	89	B+VE	NORMAL	-----	NORMAL	NORMAL
JKWC	S3130	SHALINI SABU	6/6	6/6	N-6	N-6	163.5	70	O+VE	NORMAL	-----	NORMAL	NORMAL
JKWC	S3150	SHAKTI SINGH SARANGDEVOT	6/6	6/6	N-6	N-6	179	66.5	AB+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	S3180	SURESH KUMAR	6/6	6/6	N-6	N-8	175.5	68.7	A+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	S3190	SUNIL SHARMA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	180	78	B+VE	NORMAL	-----	NORMAL	NORMAL
JKWC	T0030	TEJ PAL SINGH	6/9 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	175	70	O+VE	-----	NORMAL	ML RE	MILD REST
JKWC	V0520	VIKAS KUMAR	6/6	6/6	N-6	N-6	172.5	78.9	B+VE	-----	NORMAL	ML LE	NORMAL
JKWC	V0560	VIJAY KHADELWAL	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	174	68.7	A+VE	NORMAL	-----	NORMAL	NORMAL
JKWC	V0580	VIRENDRA SINGH RATHORE	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	179	84.8	B+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	V0630	VINAYAK SONI	6/6	6/6	N-6	N-6	162	64	B+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	V0640	VIJAY SONI	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	176.5	86	B+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	V0660	VIPIN KUMAR SINGH	6/6	6/6	N-6	N-6	175	77.5	B+VE	-----	NORMAL	NORMAL	MILD REST
JKWC	V0690	VINOD KUMAR GOUR	6/6	6/9	N-8	N-8	182	85.5	B+VE	NORMAL	-----	NORMAL	NORMAL
JKWC	V0700	VINAY KUMAR JAIN	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	172	73	B+VE	-----	NORAML	NORMAL	NORMAL
JKWC	V0710	VIRENDRA KUMAWAT	6/6	6/6	N-6	N-6	169	54.5	A+VE	-----	NORMAL	ML LE	NORMAL
JKWC	V0730	VIPUL KUMAR OJHA	6/6 C GLS	6/6 C GLS	N-6 C GLS	N-6 C GLS	157	97	B+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	Y0030	YOGENDRA VYAS	6/6	6/6	N-6	N-6	172	81.5	B+VE	-----	NORMAL	NORMAL	NORMAL
JKWC	Y0080	YOGESH NAGAR	6/6	6/6	N-6	N-6							